

7447

BOARD DIPLOMA EXAMINATION, (C-20) OCTOBER/NOVEMBER—2023

DEEE - FOURTH SEMESTER EXAMINATION

ELECTRICAL INSTALLATION AND ESTIMATION

Time: 3 Hours [Total Marks: 80

PART—A

 $3 \times 10 = 30$

Instructions: (1) Answer **all** questions.

- (2) Each question carries **three** marks.
- (3) Answers should be brief and straight to the point and shall not exceed five simple sentences.
- **1.** Classify the cables according to voltage.
- **2.** State the reasons for fire accidents in electrical systems.
- **3.** List various types of interior wiring systems.
- **4.** Calculate the size of cable required for 7·5 HP, 400 V, 3-phase, 50 Hz squirrel cage induction motor. Assume efficiency of the motor as 85% and power factor as 0·8 lagging.
- **5.** Draw the connection of service wire between LT pole and irrigation pump shed.
- **6.** Classify the earthing along with applications.
- **7.** Calculate the number of various insulators needed for the erection of 500 m, 3-phase, 11 kV overhead line with two-angle points and two turning points. The length of span is 70 m.
- **8.** List any six main components of 11 kV overhead line.

/7447 1 [Contd...

- **9.** What are the important tests to be conducted before energizing a wiring installation?
- **10.** Write down the permissible earth resistance value for the following :
 - (a) 1 HP, 1-phase, 230 V, 50 Hz motor
 - (b) A 33/11 kV, 2 MVA sub-station
 - (c) 10 MW power generating plant

PART—B 8×5=40

Instructions: (1) Answer either (a) or (b) from each question.

- (2) Each question carries eight marks.
- (3) Answers should be comprehensive and criterion for valuation is the content but not the length of the answer.
- **11.** (a) Explain the procedure of first aid to be adopted for shock treatment to an electrocuted person.

(OR)

- (b) Explain TRS wiring system with neat sketch and mention their advantages and disadvantages.
- 12. (a) A 7.5 HP, 415 V, 3-phase, 50 Hz squirrel cage induction motor is to be installed in a workshop for which the plan is shown in figure below. Efficiency and power factors are 85% and 0.8 lagging. Draw the wiring diagram and estimate the quantity of materials required. Assume any missing data.

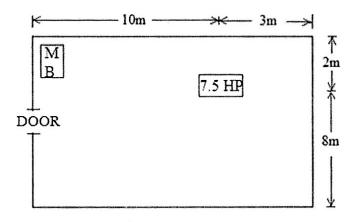


Fig. Plan of workshop

/7447 2 [Contd...

- (b) Draw the wiring layout for a workshop/electrical laboratory.
- **13.** (a) Estimate the quantity of materials required for a surface conduit system of wiring in a house, whose plan is shown in figure. Consider wattage of lamps = 60 W, fans = 80 W, light socket = 100 W




Fig. Plan of house

(OR)

- (b) Draw a neat sketch of a submersible irrigation pump set of 7.5 kW, 3-phase, 415 V, 50 Hz motor positioned at a depth of 15 m in a tube well from the ground level. The distance between the nearest L.T pole and switch control room is 15 m and distance between switch control room and tube well is 3 m. The pump shed dimensions are 4 m × 3 m × 3 m. Efficiency and power factors are 85% and 0.8 lagging respectively. Estimate the quantity of materials required and draw the wiring diagram. Assume any missing data.
- **14.** (a) Draw a neat sketch of 250 kVA, 11 kV/415 V, 50 Hz plinth mounted sub-station and estimate the quantity of materials required.

(OR)

- (b) Draw a neat sketch of pipe earthing and list out the quantity of materials required.
- **15.** (a) Explain the need for load survey in a rural electrification scheme.

(b) Determine the voltage regulation of a 11 kV line with regulation constant 900, connecting from 33/11 kV substation. The loads connected to the line are shown in the figure. Assume diversity factor = 1.5 and power factor = 0.8 lagging.




Fig. Load particulars of 11 kV line

PART—C

 $10 \times 1 = 10$

- **Instructions:** (1) Answer the following question.
 - (2) The question carries **ten** marks.
 - (3) Answer should be comprehensive and the criterion for valuation is the content but not the length of the answer.
- 16. Estimate the quantity of materials required for a 11 kV overhead line of length 3 km. The height of pole is 10 m. ACSR conductor of size 7/ 2.11 mm is used. Assume two cut points and three 90° angle points and consider a span of 70 m.